

SOKEI FIRE

sokeifire.com

BOX HYDRANT · INDONESIAN STANDARD SIZES (TIPE A1 / A2 / B / C) · DRAWING PACK

REV. 01 · 2026-09-10

SHEET	DRAWING No.	NOMINAL SIZE (W x H x D)	WIDTH mm	HEIGHT mm	DEPTH mm	MOUNTING	APPLICATION
2	SK-ID-A1-SUR	66 x 52 x 15 cm (tinggi x lebar x dalam)	520	660	150	SURFACE	Selang 1.5 in x 30 m, nozzle 1.5 in, hydrant valve 1.5 in
3	SK-ID-A1-REC	66 x 52 x 15 cm (tinggi x lebar x dalam)	520	660	150	RECESSED	Selang 1.5 in x 30 m, nozzle 1.5 in, hydrant valve 1.5 in
4	SK-ID-A2-SUR	100 x 80 x 18 cm (tinggi x lebar x dalam)	800	1000	180	SURFACE	Hose rack, selang 1.5 in x 30 m with machino coupling, nozzle, hydrant valve
5	SK-ID-A2-REC	100 x 80 x 18 cm (tinggi x lebar x dalam)	800	1000	180	RECESSED	Hose rack, selang 1.5 in x 30 m with machino coupling, nozzle, hydrant valve
6	SK-ID-B-SUR	125 x 75 x 18 cm (tinggi x lebar x dalam)	750	1250	180	SURFACE	As tipe A2, plus an upper alarm compartment: alarm bell, indicating lamp, manual call point
7	SK-ID-C-STD	95 x 66 x 20 cm (tinggi x lebar x dalam)	660	950	200	ON LEGS	Selang 2.5 in x 30 m, nozzle 2.5 in, pillar hydrant key
8	SK-ID-C-SUR	95 x 66 x 20 cm (tinggi x lebar x dalam)	660	950	200	SURFACE	Selang 2.5 in x 30 m, nozzle 2.5 in, pillar hydrant key

HOW THESE SIZES WERE ESTABLISHED

Indonesian projects specify box hydrant by tipe. Catalogues quote centimetres as tinggi x lebar x dalam (height x width x depth) - these drawings carry both that figure and the millimetre W x H x D used on the shop floor.

- tipe A1 66 x 52 x 15 cm = 520 x 660 x 150 mm - indoor, ruko and small office
- tipe A2 100 x 80 x 18 cm = 800 x 1000 x 180 mm - indoor, office and factory corridor
- tipe B 125 x 75 x 18 cm = 750 x 1250 x 180 mm - indoor, with the alarm compartment on top
- tipe C 95 x 66 x 20 cm = 660 x 950 x 200 mm - outdoor, on legs beside the pillar hydrant


Body is plat besi 1.2 mm (1.2-1.5 mm outdoor), powder coating merah, pintu kaca 3 mm with a rubber strip and a cylinder lock.

Doors carry HYDRANT in white. Galvanised and SUS 304 bodies are made for coastal and chemical sites.

ALL DRAWINGS ALSO SUPPLIED AS DXF (AutoCAD R2013, 1:1 in mm) - SEE ACCOMPANYING FILES.

FRONT ELEVATION

SIDE SECTION

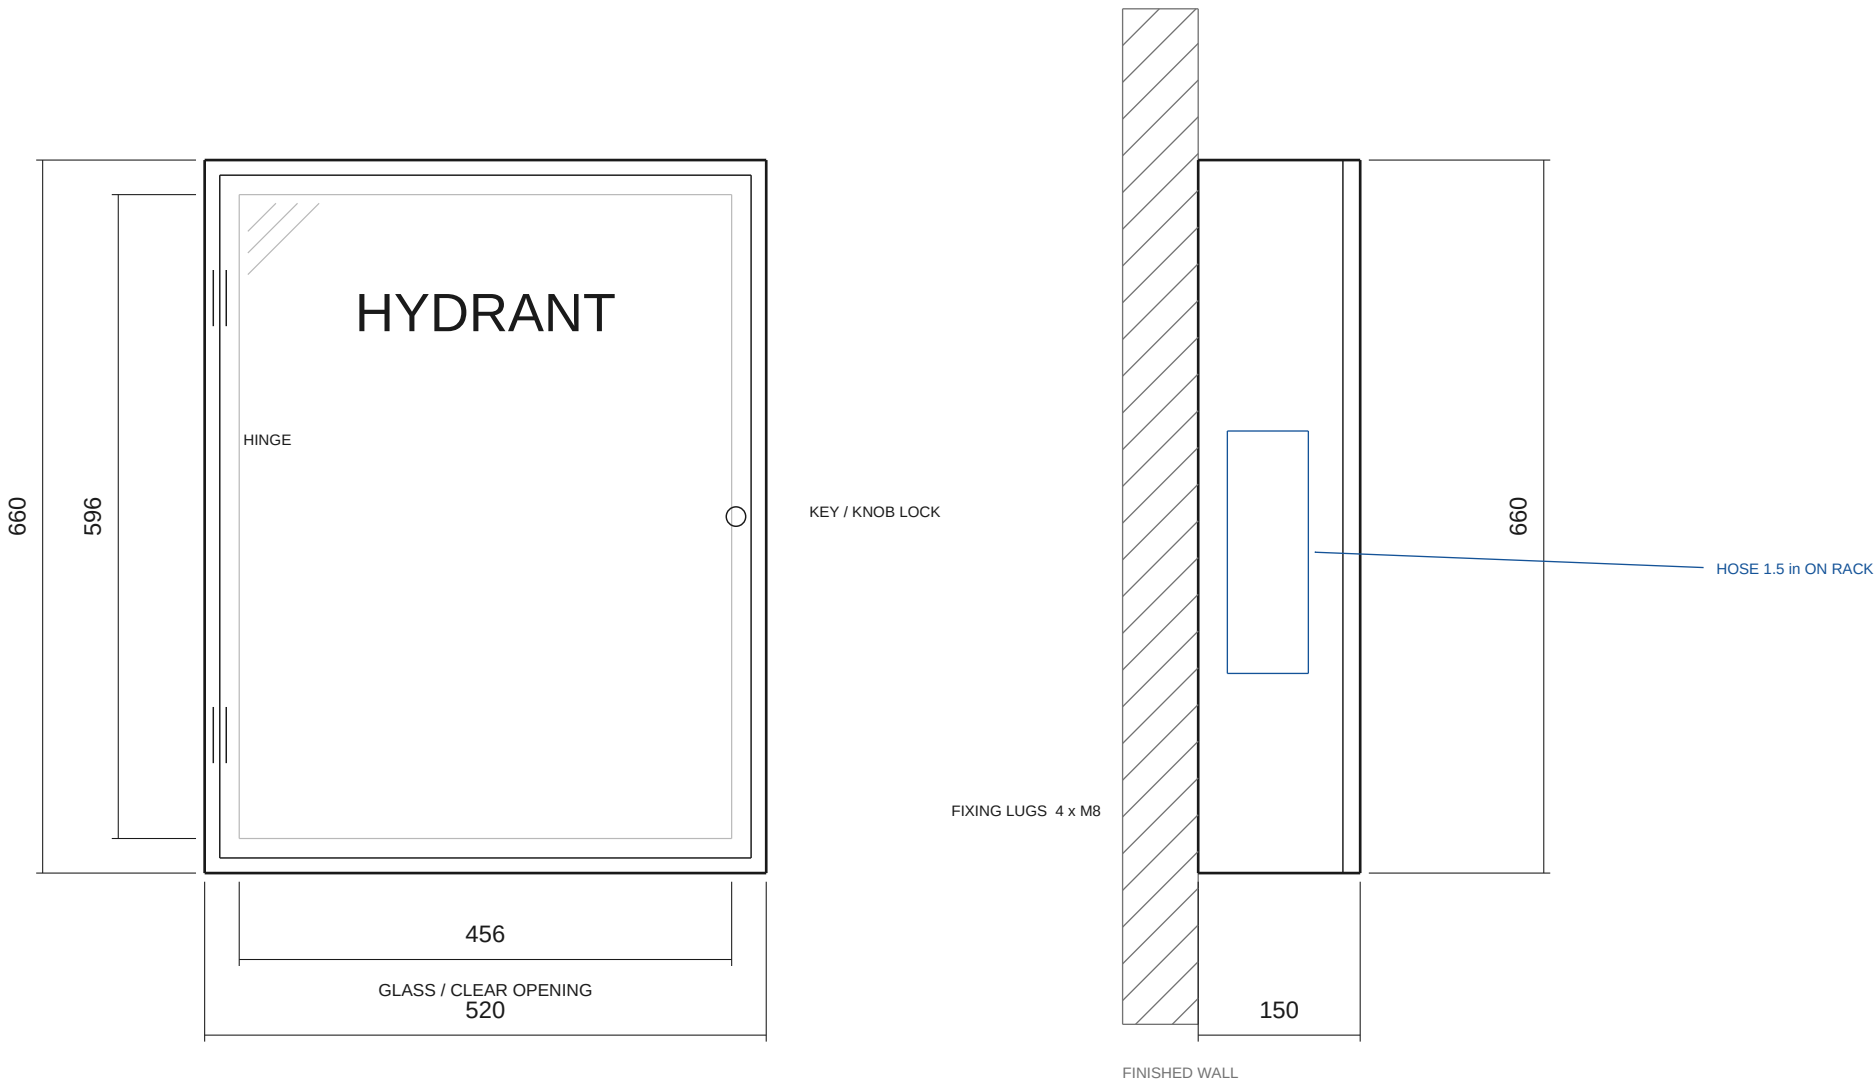

APPLICATION · SK-ID-A1

NOMINAL TRADE SIZE

66 x 52 x 15 cm (tinggi x lebar x dalam)

METRIC (W x H x D)

520 x 660 x 150 mm

MOUNTING

SURFACE, WALL MOUNTED

CONTENTS

Selang 1.5 in x 30 m, nozzle 1.5 in, hydrant valve 1.5 in

BODY

Plat besi (CRS) 1.2 mm, powder coating merah

DOOR

Pintu kaca 3 mm with a rubber glazing strip, in a steel door

HARDWARE

Cylinder lock with key, steel hinges

MOUNTING HEIGHT

Box centreline 1200-1500 mm above floor typical; tipe C legs set the door at working height

CODE BASIS

Sizes to the Indonesian tipe A1/A2/B/C convention; installation to SNI 03-1745 and the local Damkar requirement

REMARK

The small indoor box - ruko, kios, small office. The most ordered size in Indonesia.

NOTES

- ALL DIMENSIONS IN MILLIMETRES, WRITTEN W x H x D. INDONESIAN CATALOGUES QUOTE CENTIMETRES AS TINGGI x LEBAR x DALAM (HEIGHT x WIDTH x DEPTH) - BOTH ARE SHOWN.
- BODY: PLAT BESI (COLD-ROLLED MILD STEEL) 1.2 mm ON TIPE A1, A2 AND B; 1.2-1.5 mm ON OUTDOOR TIPE C. GALVANISED OR SUS 304 FOR COASTAL SITES.
- FINISH: POWDER COATING MERAH (RED) - THE INDONESIAN CONVENTION. WHITE, YELLOW OR ANY RAL FROM 300 pcs.
- GLAZING: PINTU KACA 3 mm WITH A RUBBER GLAZING STRIP (LIST KARET) - THE LOCAL STANDARD. 5 mm GLASS, POLYCARBONATE OR PINTU POLOS (SOLID STEEL) ON REQUEST.
- HARDWARE: CYLINDER LOCK WITH KEY, STEEL HINGES. BREAK-GLASS OR PADLOCK HASP ON REQUEST.
- LETTERING: "HYDRANT" IN WHITE ON THE RED DOOR. "FIRE HYDRANT", "APAR" OR A BILINGUAL FACE ON REQUEST. TIPE B CARRIES THE ALARM LEGEND ON THE UPPER PANEL.
- TOLERANCE ON OVERALL DIMENSIONS: +/- 2 mm. OUTDOOR TIPE C HAS A GASKETED DOOR, A DRIP LIP AND FABRICATED LEGS (KAKI) TO STAND BESIDE A PILLAR HYDRANT.
- ISI (CONTENTS) ARE BOUGHT-IN ITEMS - SELANG, NOZZLE, HYDRANT VALVE, MACHINO COUPLING, HOSE RACK. SIZES FOLLOW THE TIPE A1 / A2 / B / C CONVENTION USED ON INDONESIAN PROJECTS. WE DO NOT HOLD SNI CERTIFICATION AND DO NOT CLAIM IT.

SOKEI FIRE

Fire hose cabinet manufacturer · sokeifire.com

INDONESIA MARKET

STANDARD SIZE DRAWING PACK

TITLE

BOX HYDRANT TIPE A1 - 520 x 660 x 150 (INDOOR, SURFACE)

NOMINAL TRADE SIZE

66 x 52 x 15 cm (tinggi x lebar x dalam)

DRAWING No.

SK-ID-A1-SUR

MOUNTING

SURFACE


UNITS

mm [inch]


SCALE

1 : 7

FRONT ELEVATION

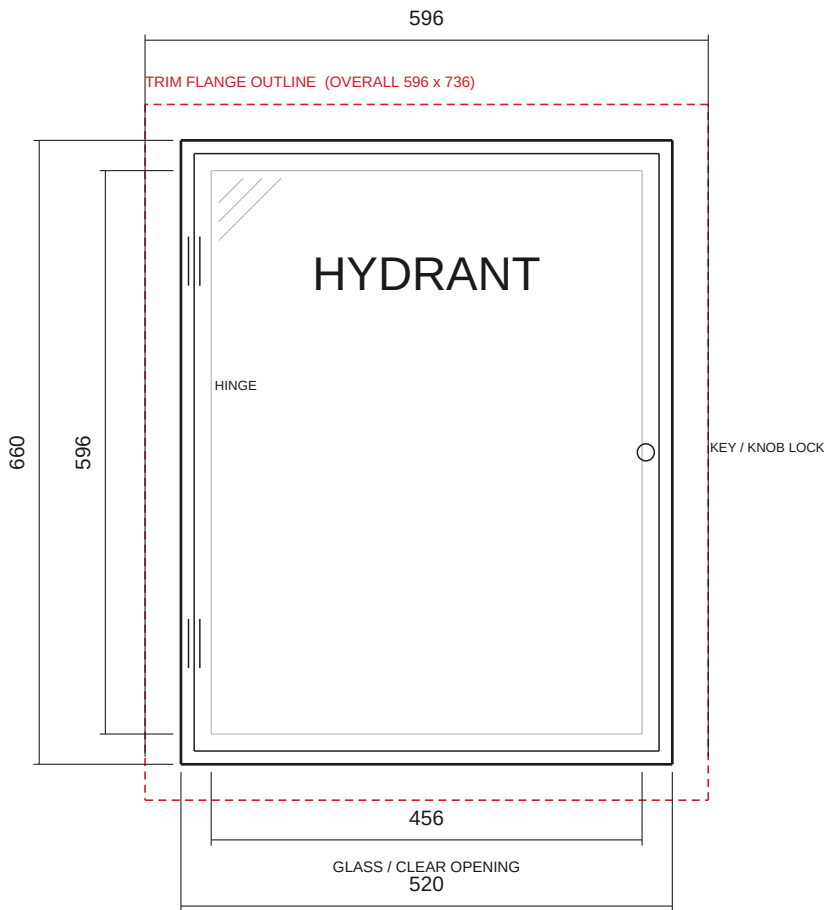

SIDE SECTION

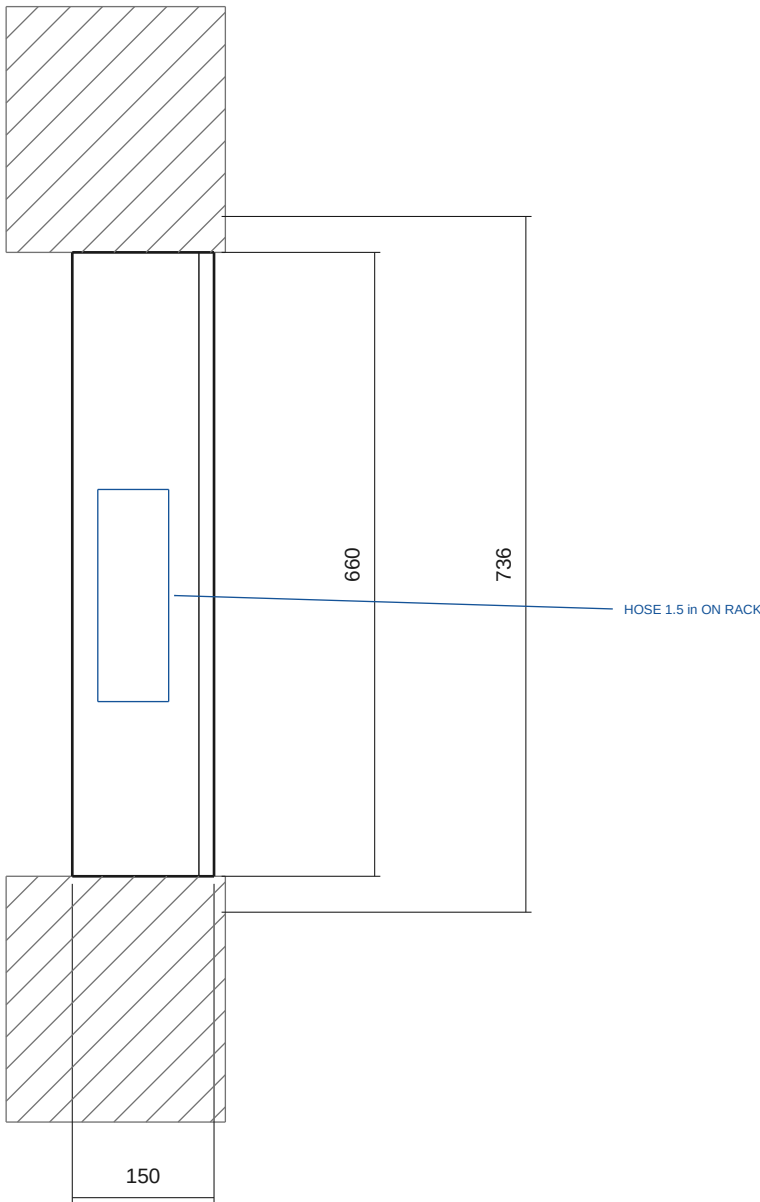

FINISHED WALL

MIN. WALL POCKET DEPTH 162

APPLICATION · SK-ID-A1-R

NOMINAL TRADE SIZE

66 x 52 x 15 cm (tinggi x lebar x dalam)

METRIC (W x H x D)

520 x 660 x 150 mm

MOUNTING

RECESSED, wall aperture 530 x 670 x 160

CONTENTS

Selang 1.5 in x 30 m, nozzle 1.5 in, hydrant valve 1.5 in

BODY

Plat besi (CRS) 1.2 mm, powder coating merah

DOOR

Pintu kaca 3 mm with a rubber glazing strip, in a steel door

HARDWARE

Cylinder lock with key, steel hinges

MOUNTING HEIGHT

Box centreline 1200-1500 mm above floor typical; tipe C legs set the door at working height

CODE BASIS

Sizes to the Indonesian tipe A1/A2/B/C convention; installation to SNI 03-1745 and the local Damkar requirement

REMARK

Same box let into the wall. 150 deep suits a 150 mm masonry wall - state the wall build-up.

NOTES

- ALL DIMENSIONS IN MILLIMETRES, WRITTEN W x H x D. INDONESIAN CATALOGUES QUOTE CENTIMETRES AS TINGGI x LEBAR x DALAM (HEIGHT x WIDTH x DEPTH) - BOTH ARE SHOWN.
- BODY: PLAT BESI (COLD-ROLLED MILD STEEL) 1.2 mm ON TIPE A1, A2 AND B; 1.2-1.5 mm ON OUTDOOR TIPE C. GALVANISED OR SUS 304 FOR COASTAL SITES.
- FINISH: POWDER COATING MERAH (RED) - THE INDONESIAN CONVENTION. WHITE, YELLOW OR ANY RAL FROM 300 pcs.
- GLAZING: PINTU KACA 3 mm WITH A RUBBER GLAZING STRIP (LIST KARET) - THE LOCAL STANDARD. 5 mm GLASS, POLYCARBONATE OR PINTU POLOS (SOLID STEEL) ON REQUEST.
- HARDWARE: CYLINDER LOCK WITH KEY, STEEL HINGES. BREAK-GLASS OR PADLOCK HASP ON REQUEST.
- LETTERING: "HYDRANT" IN WHITE ON THE RED DOOR. "FIRE HYDRANT", "APAR" OR A BILINGUAL FACE ON REQUEST. TIPE B CARRIES THE ALARM LEGEND ON THE UPPER PANEL.
- TOLERANCE ON OVERALL DIMENSIONS: +/- 2 mm. OUTDOOR TIPE C HAS A GASKETED DOOR, A DRIP LIP AND FABRICATED LEGS (KAKI) TO STAND BESIDE A PILLAR HYDRANT.
- ISI (CONTENTS) ARE BOUGHT-IN ITEMS - SELANG, NOZZLE, HYDRANT VALVE, MACHINO COUPLING, HOSE RACK. SIZES FOLLOW THE TIPE A1 / A2 / B / C CONVENTION USED ON INDONESIAN PROJECTS. WE DO NOT HOLD SNI CERTIFICATION AND DO NOT CLAIM IT.

SOKEI FIRE

Fire hose cabinet manufacturer · sokeifire.com

INDONESIA MARKET

STANDARD SIZE DRAWING PACK

TITLE

BOX HYDRANT TIPE A1 - 520 x 660 x 150 (INDOOR, RECESSED)

NOMINAL TRADE SIZE

66 x 52 x 15 cm (tinggi x lebar x dalam)

DRAWING No.

SK-ID-A1-REC

MOUNTING

RECESSED

UNITS


mm [inch]

SCALE

1 : 8

FRONT ELEVATION

SIDE SECTION

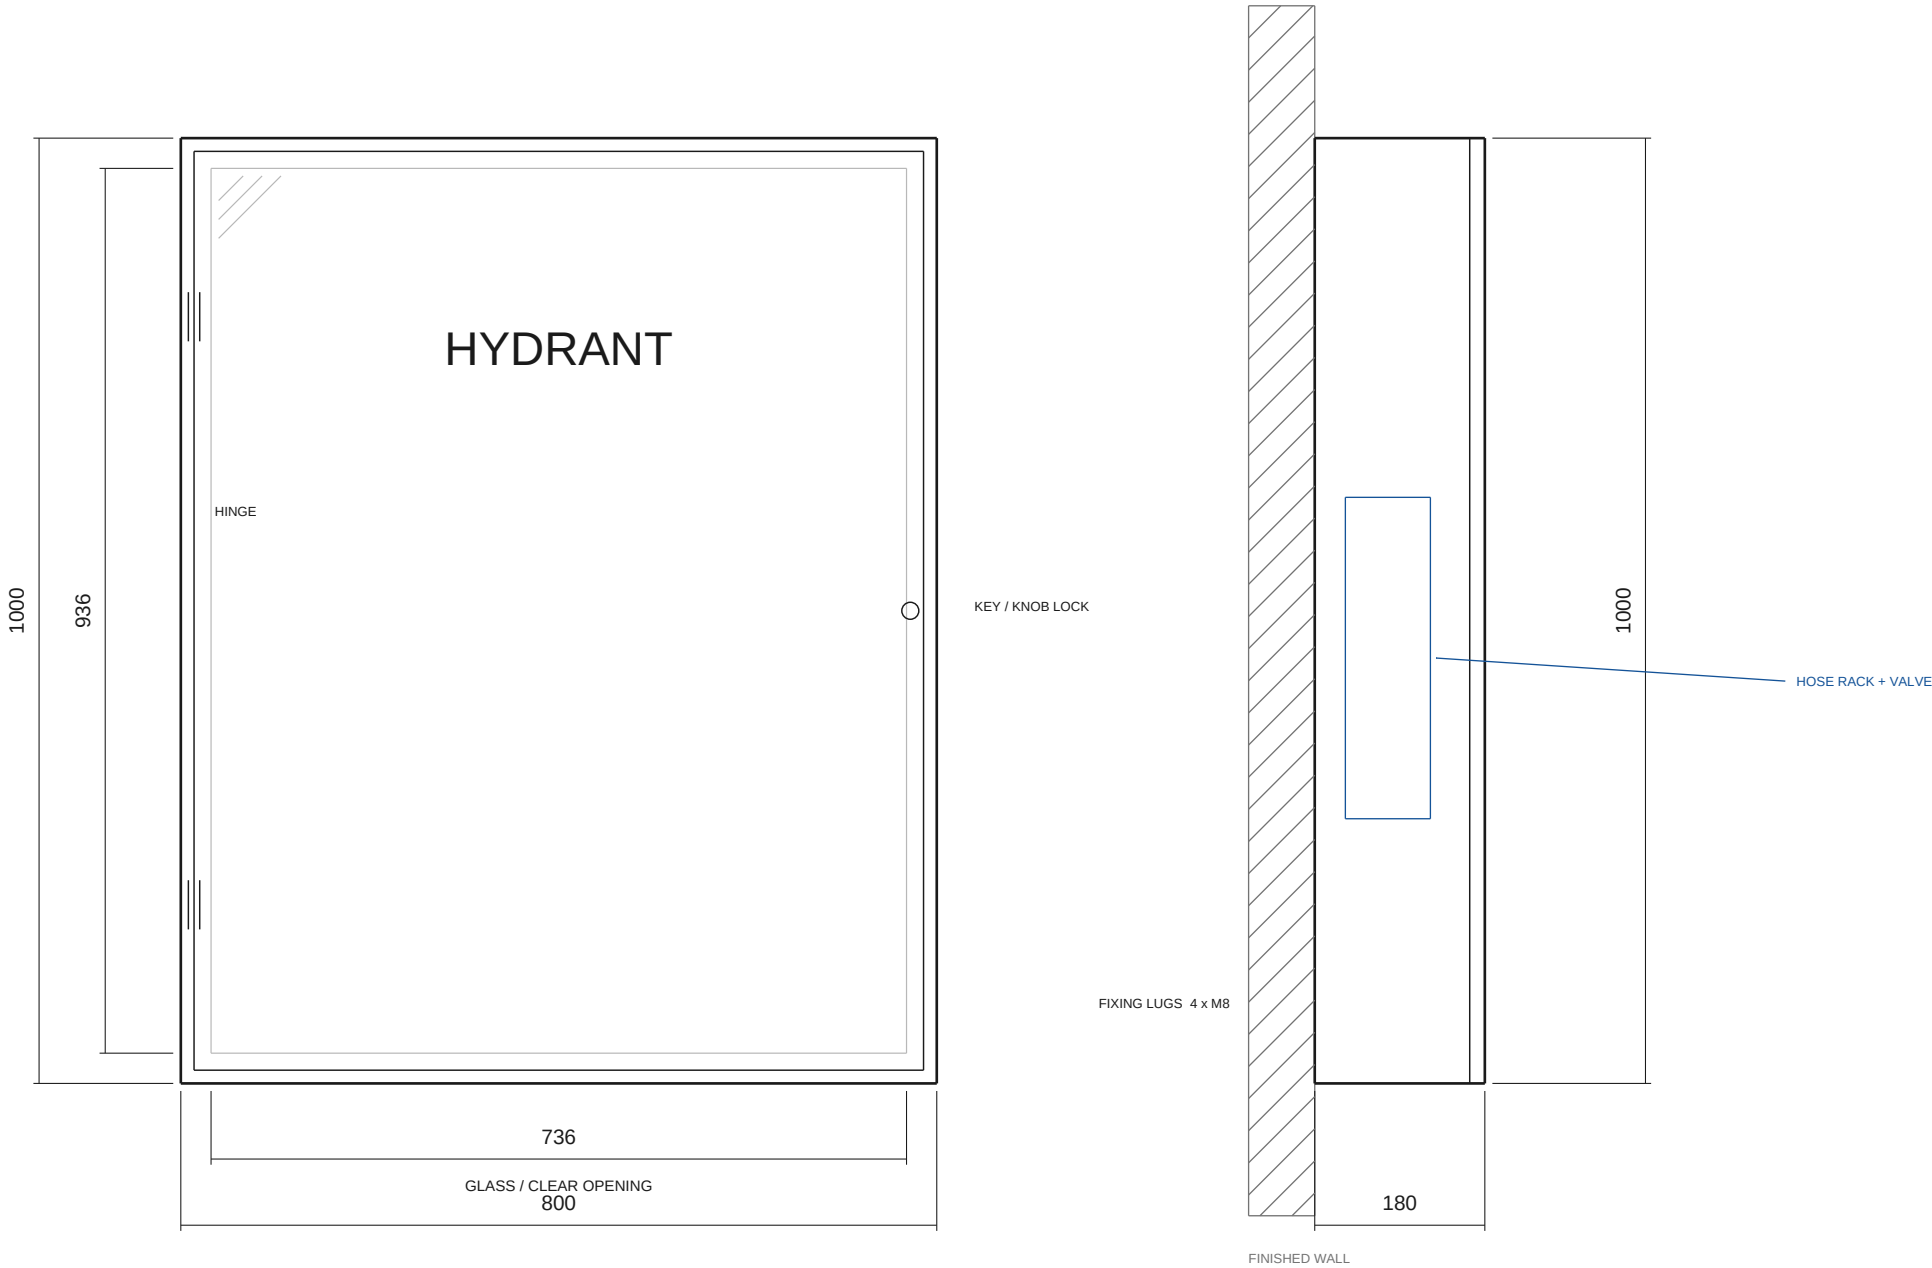

APPLICATION · SK-ID-A2

NOMINAL TRADE SIZE

100 x 80 x 18 cm (tinggi x lebar x dalam)

METRIC (W x H x D)

800 x 1000 x 180 mm

MOUNTING

SURFACE, WALL MOUNTED

CONTENTS

Hose rack, selang 1.5 in x 30 m with machino coupling, nozzle, hydrant valve

BODY

Plat besi (CRS) 1.2 mm, powder coating merah

DOOR

Pintu kaca 3 mm with a rubber glazing strip, in a steel door

HARDWARE

Cylinder lock with key, steel hinges

MOUNTING HEIGHT

Box centreline 1200-1500 mm above floor typical; tipe C legs set the door at working height

CODE BASIS

Sizes to the Indonesian tipe A1/A2/B/C convention; installation to SNI 03-1745 and the local Damkar requirement

REMARK

The office and factory corridor size. Takes a full hose rack behind the glass door.

NOTES

- ALL DIMENSIONS IN MILLIMETRES, WRITTEN W x H x D. INDONESIA CATALOGUES QUOTE CENTIMETRES AS TINGGI x LEBAR x DALAM (HEIGHT x WIDTH x DEPTH) - BOTH ARE SHOWN.
- BODY: PLAT BESI (COLD-ROLLED MILD STEEL) 1.2 mm ON TIPE A1, A2 AND B; 1.2-1.5 mm ON OUTDOOR TIPE C. GALVANISED OR SUS 304 FOR COASTAL SITES.
- FINISH: POWDER COATING MERAH (RED) - THE INDONESIAN CONVENTION. WHITE, YELLOW OR ANY RAL FROM 300 pcs.
- GLAZING: PINTU KACA 3 mm WITH A RUBBER GLAZING STRIP (LIST KARET) - THE LOCAL STANDARD. 5 mm GLASS, POLYCARBONATE OR PINTU POLOS (SOLID STEEL) ON REQUEST.
- HARDWARE: CYLINDER LOCK WITH KEY, STEEL HINGES. BREAK-GLASS OR PADLOCK HASP ON REQUEST.
- LETTERING: "HYDRANT" IN WHITE ON THE RED DOOR. "FIRE HYDRANT", "APAR" OR A BILINGUAL FACE ON REQUEST. TIPE B CARRIES THE ALARM LEGEND ON THE UPPER PANEL.
- TOLERANCE ON OVERALL DIMENSIONS: +/- 2 mm. OUTDOOR TIPE C HAS A GASKETED DOOR, A DRIP LIP AND FABRICATED LEGS (KAKI) TO STAND BESIDE A PILLAR HYDRANT.
- ISI (CONTENTS) ARE BOUGHT-IN ITEMS - SELANG, NOZZLE, HYDRANT VALVE, MACHINO COUPLING, HOSE RACK. SIZES FOLLOW THE TIPE A1 / A2 / B / C CONVENTION USED ON INDONESIA PROJECTS. WE DO NOT HOLD SNI CERTIFICATION AND DO NOT CLAIM IT.

SOKEI FIRE

Fire hose cabinet manufacturer · sokeifire.com

INDONESIA MARKET

STANDARD SIZE DRAWING PACK

TITLE

BOX HYDRANT TIPE A2 - 800 x 1000 x 180 (INDOOR, SURFACE)

NOMINAL TRADE SIZE

100 x 80 x 18 cm (tinggi x lebar x dalam)

DRAWING No.

SK-ID-A2-SUR

MOUNTING

SURFACE


UNITS

mm [inch]


SCALE

1 : 8

FRONT ELEVATION

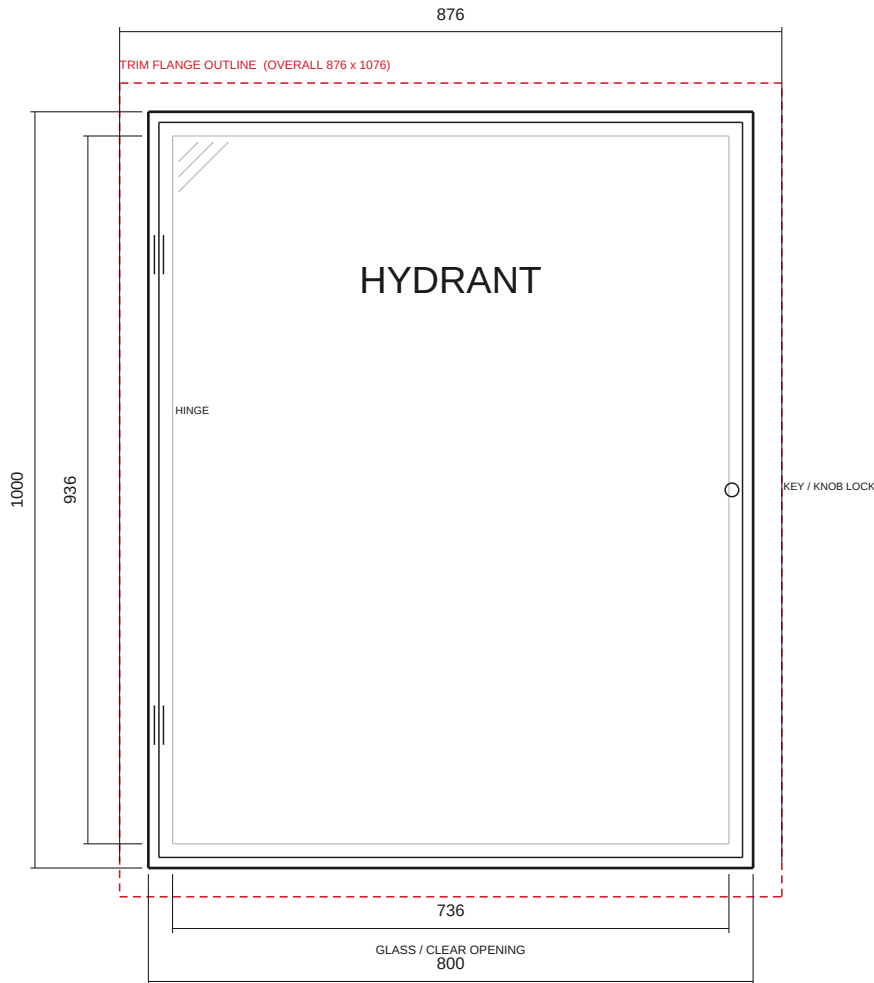

SIDE SECTION

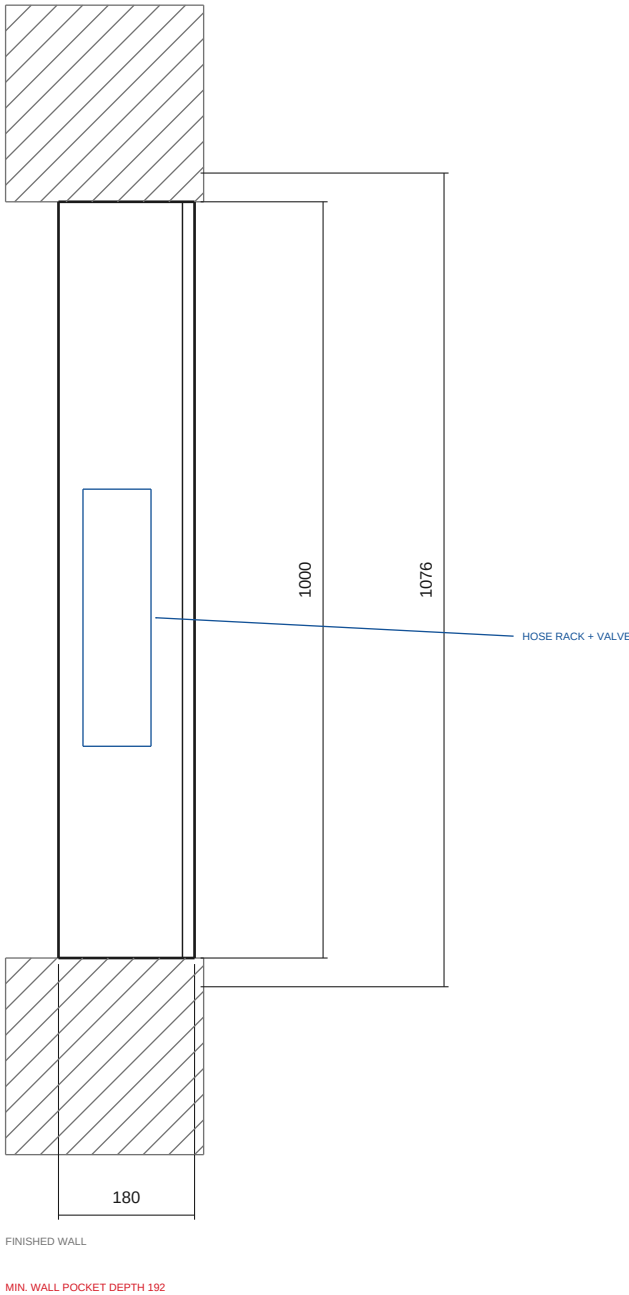

APPLICATION · SK-ID-A2-R

- NOMINAL TRADE SIZE**
100 x 80 x 18 cm (tinggi x lebar x dalam)
- METRIC (W x H x D)**
800 x 1000 x 180 mm
- MOUNTING**
RECESSED, wall aperture 810 x 1010 x 190
- CONTENTS**
Hose rack, selang 1.5 in x 30 m with machino coupling, nozzle, hydrant valve
- BODY**
Plat besi (CRS) 1.2 mm, powder coating merah
- DOOR**
Pintu kaca 3 mm with a rubber glazing strip, in a steel door
- HARDWARE**
Cylinder lock with key, steel hinges
- MOUNTING HEIGHT**
Box centreline 1200-1500 mm above floor typical; tipe C legs set the door at working height
- CODE BASIS**
Sizes to the Indonesian tipe A1/A2/B/C convention; installation to SNI 03-1745 and the local Damkar requirement
- REMARK**
Recessed tipe A2 for mall and apartment corridors where the box must sit flush.

NOTES

- ALL DIMENSIONS IN MILLIMETRES, WRITTEN W x H x D. INDONESIAN CATALOGUES QUOTE CENTIMETRES AS TINGGI x LEBAR x DALAM (HEIGHT x WIDTH x DEPTH) - BOTH ARE SHOWN.
- BODY: PLAT BESI (COLD-ROLLED MILD STEEL) 1.2 mm ON TYPE A1, A2 AND B; 1.2-1.5 mm ON OUTDOOR TYPE C. GALVANISED OR SUS 304 FOR COASTAL SITES.
- FINISH: POWDER COATING MERAH (RED) - THE INDONESIAN CONVENTION. WHITE, YELLOW OR ANY RAL FROM 300 pcs.
- GLAZING: PINTU KACA 3 mm WITH A RUBBER GLAZING STRIP (LIST KARET) - THE LOCAL STANDARD. 5 mm GLASS, POLYCARBONATE OR PINTU POLOS (SOLID STEEL) ON REQUEST.
- HARDWARE: CYLINDER LOCK WITH KEY, STEEL HINGES. BREAK-GLASS OR PADLOCK HASP ON REQUEST.
- LETTERING: "HYDRANT" IN WHITE ON THE RED DOOR. "FIRE HYDRANT", "APAR" OR A BILINGUAL FACE ON REQUEST. TYPE B CARRIES THE ALARM LEGEND ON THE UPPER PANEL.
- TOLERANCE ON OVERALL DIMENSIONS: +/- 2 mm. OUTDOOR TYPE C HAS A GASKETED DOOR, A DRIP LIP AND FABRICATED LEGS (KAKI) TO STAND BESIDE A PILLAR HYDRANT.
- ISI (CONTENTS) ARE BOUGHT-IN ITEMS - SELANG, NOZZLE, HYDRANT VALVE, MACHINO COUPLING, HOSE RACK. SIZES FOLLOW THE TYPE A1 / A2 / B / C CONVENTION USED ON INDONESIAN PROJECTS. WE DO NOT HOLD SNI CERTIFICATION AND DO NOT CLAIM IT.

SOKEI FIRE

Fire hose cabinet manufacturer · sokeifire.com

INDONESIA MARKET

STANDARD SIZE DRAWING PACK

TITLE
BOX HYDRANT TIPE A2 - 800 x 1000 x 180 (INDOOR, RECESSED)

NOMINAL TRADE SIZE
100 x 80 x 18 cm (tinggi x lebar x dalam)

DRAWING No.
SK-ID-A2-REC


MOUNTING
RECESSED

UNITS
mm [inch]

SCALE
1 : 10

FRONT ELEVATION

SIDE SECTION

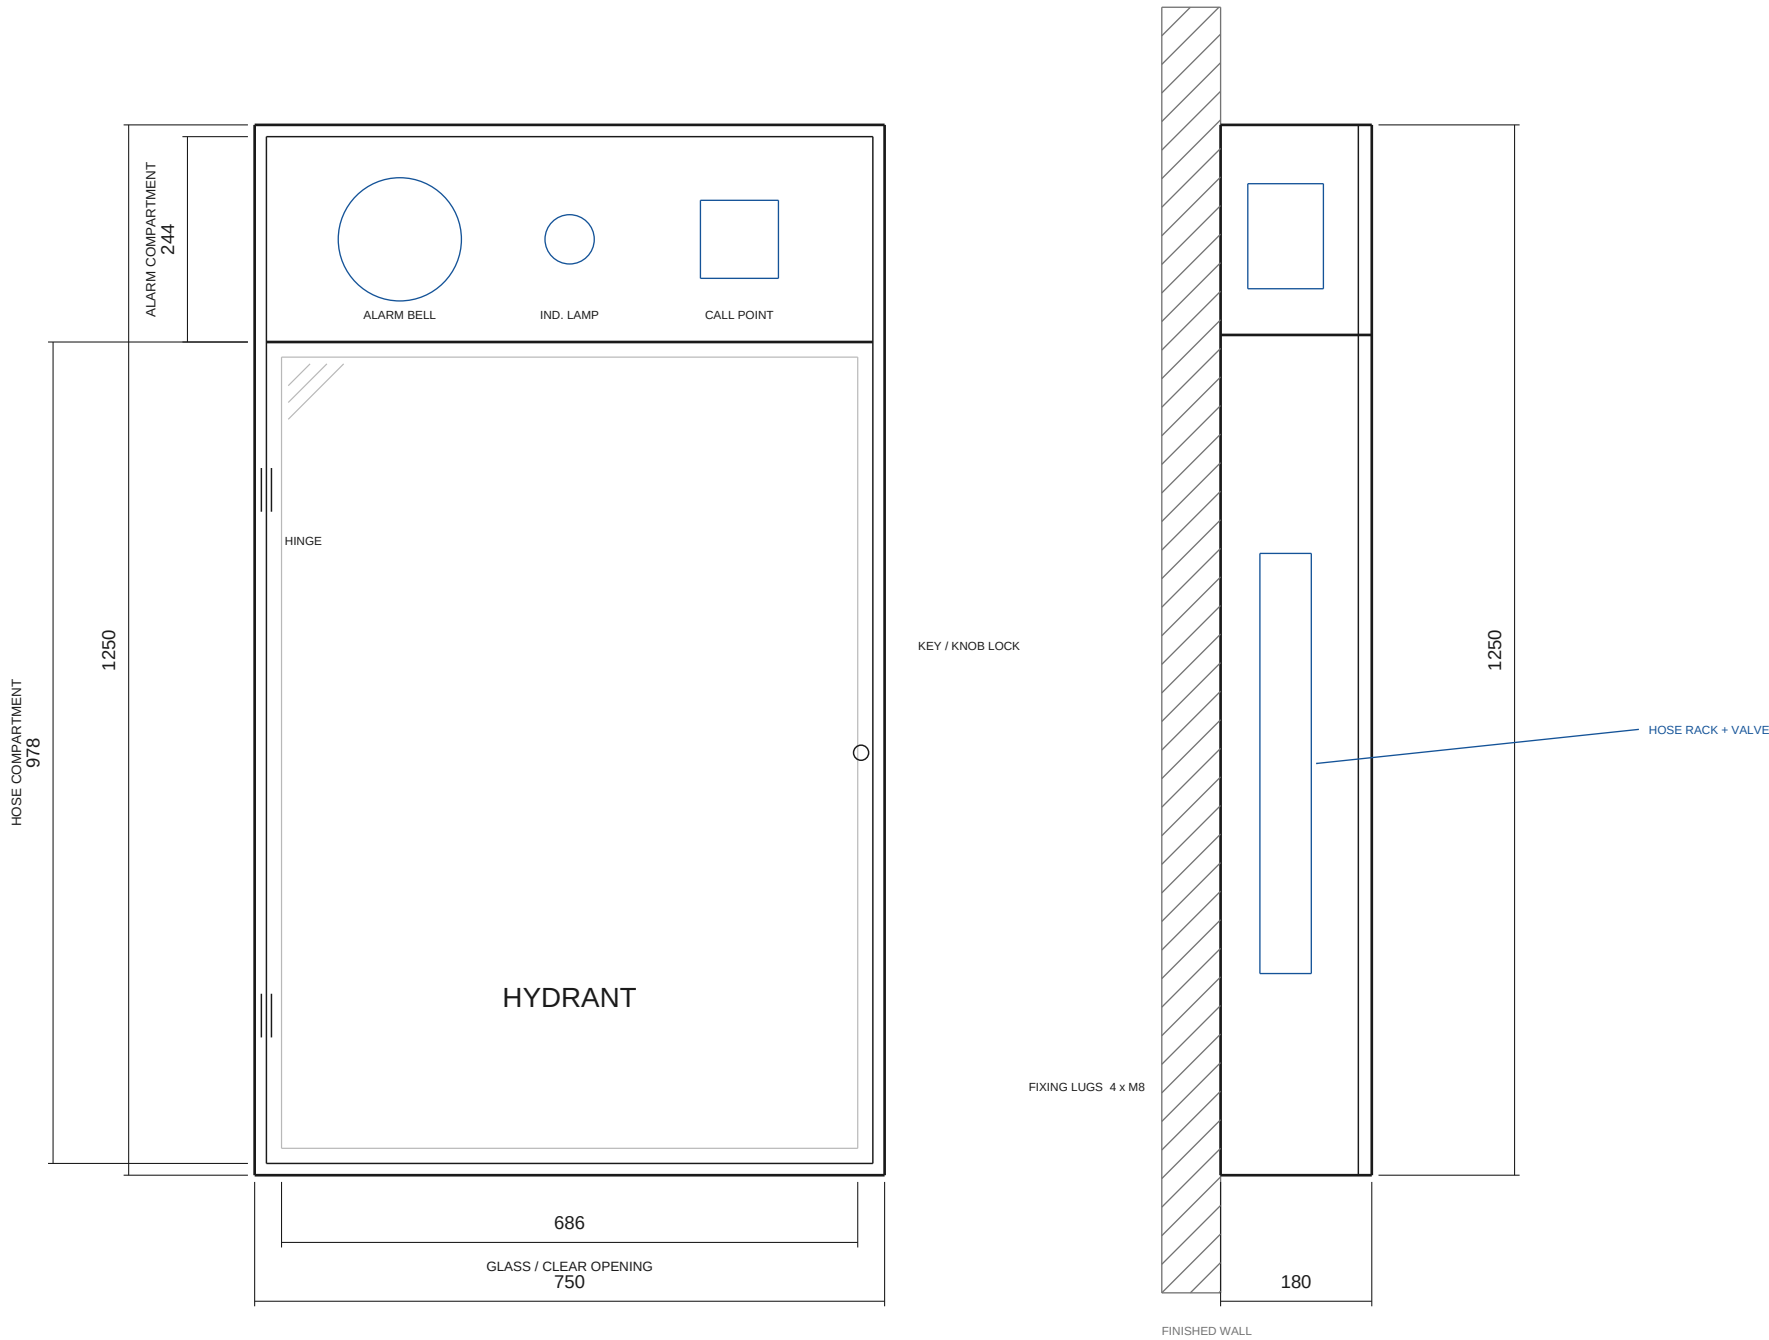

APPLICATION · SK-ID-B

NOMINAL TRADE SIZE

125 x 75 x 18 cm (tinggi x lebar x dalam)

METRIC (W x H x D)

750 x 1250 x 180 mm

MOUNTING

SURFACE, WALL MOUNTED

CONTENTS

As tipe A2, plus an upper alarm compartment: alarm bell, indicating lamp, manual call point

BODY

Plat besi (CRS) 1.2 mm, powder coating merah

DOOR

Pintu kaca 3 mm with a rubber glazing strip, in a steel door

HARDWARE

Cylinder lock with key, steel hinges

MOUNTING HEIGHT

Box centreline 1200-1500 mm above floor typical; tipe C legs set the door at working height

CODE BASIS

Sizes to the Indonesian tipe A1/A2/B/C convention; installation to SNI 03-1745 and the local Damkar requirement

REMARK

Tipe B is tipe A2 with the alarm section on TOP, divided by a sekat. Hotel, mall, apartment.

NOTES

- ALL DIMENSIONS IN MILLIMETRES, WRITTEN W x H x D. INDONESIA CATALOGUES QUOTE CENTIMETRES AS TINGGI x LEBAR x DALAM (HEIGHT x WIDTH x DEPTH) - BOTH ARE SHOWN.
- BODY: PLAT BESI (COLD-ROLLED MILD STEEL) 1.2 mm ON TIPE A1, A2 AND B; 1.2-1.5 mm ON OUTDOOR TIPE C. GALVANISED OR SUS 304 FOR COASTAL SITES.
- FINISH: POWDER COATING MERAH (RED) - THE INDONESIA CONVENTION. WHITE, YELLOW OR ANY RAL FROM 300 pcs.
- GLAZING: PINTU KACA 3 mm WITH A RUBBER GLAZING STRIP (LIST KARET) - THE LOCAL STANDARD. 5 mm GLASS, POLYCARBONATE OR PINTU POLOS (SOLID STEEL) ON REQUEST.
- HARDWARE: CYLINDER LOCK WITH KEY, STEEL HINGES. BREAK-GLASS OR PADLOCK HASP ON REQUEST.
- LETTERING: "HYDRANT" IN WHITE ON THE RED DOOR. "FIRE HYDRANT", "APAR" OR A BILINGUAL FACE ON REQUEST. TIPE B CARRIES THE ALARM LEGEND ON THE UPPER PANEL.
- TOLERANCE ON OVERALL DIMENSIONS: +/- 2 mm. OUTDOOR TIPE C HAS A GASKETED DOOR, A DRIP LIP AND FABRICATED LEGS (KAKI) TO STAND BESIDE A PILLAR HYDRANT.
- ISI (CONTENTS) ARE BOUGHT-IN ITEMS - SELANG, NOZZLE, HYDRANT VALVE, MACHINO COUPLING, HOSE RACK. SIZES FOLLOW THE TIPE A1 / A2 / B / C CONVENTION USED ON INDONESIA PROJECTS. WE DO NOT HOLD SNI CERTIFICATION AND DO NOT CLAIM IT.

SOKEI FIRE

Fire hose cabinet manufacturer · sokeifire.com

INDONESIA MARKET

STANDARD SIZE DRAWING PACK

TITLE

BOX HYDRANT TIPE B - 750 x 1250 x 180 (INDOOR, WITH ALARM COMPARTMENT)

NOMINAL TRADE SIZE

125 x 75 x 18 cm (tinggi x lebar x dalam)

DRAWING No.

SK-ID-B-SUR

MOUNTING


SURFACE

UNITS

mm [inch]

SCALE

1 : 9

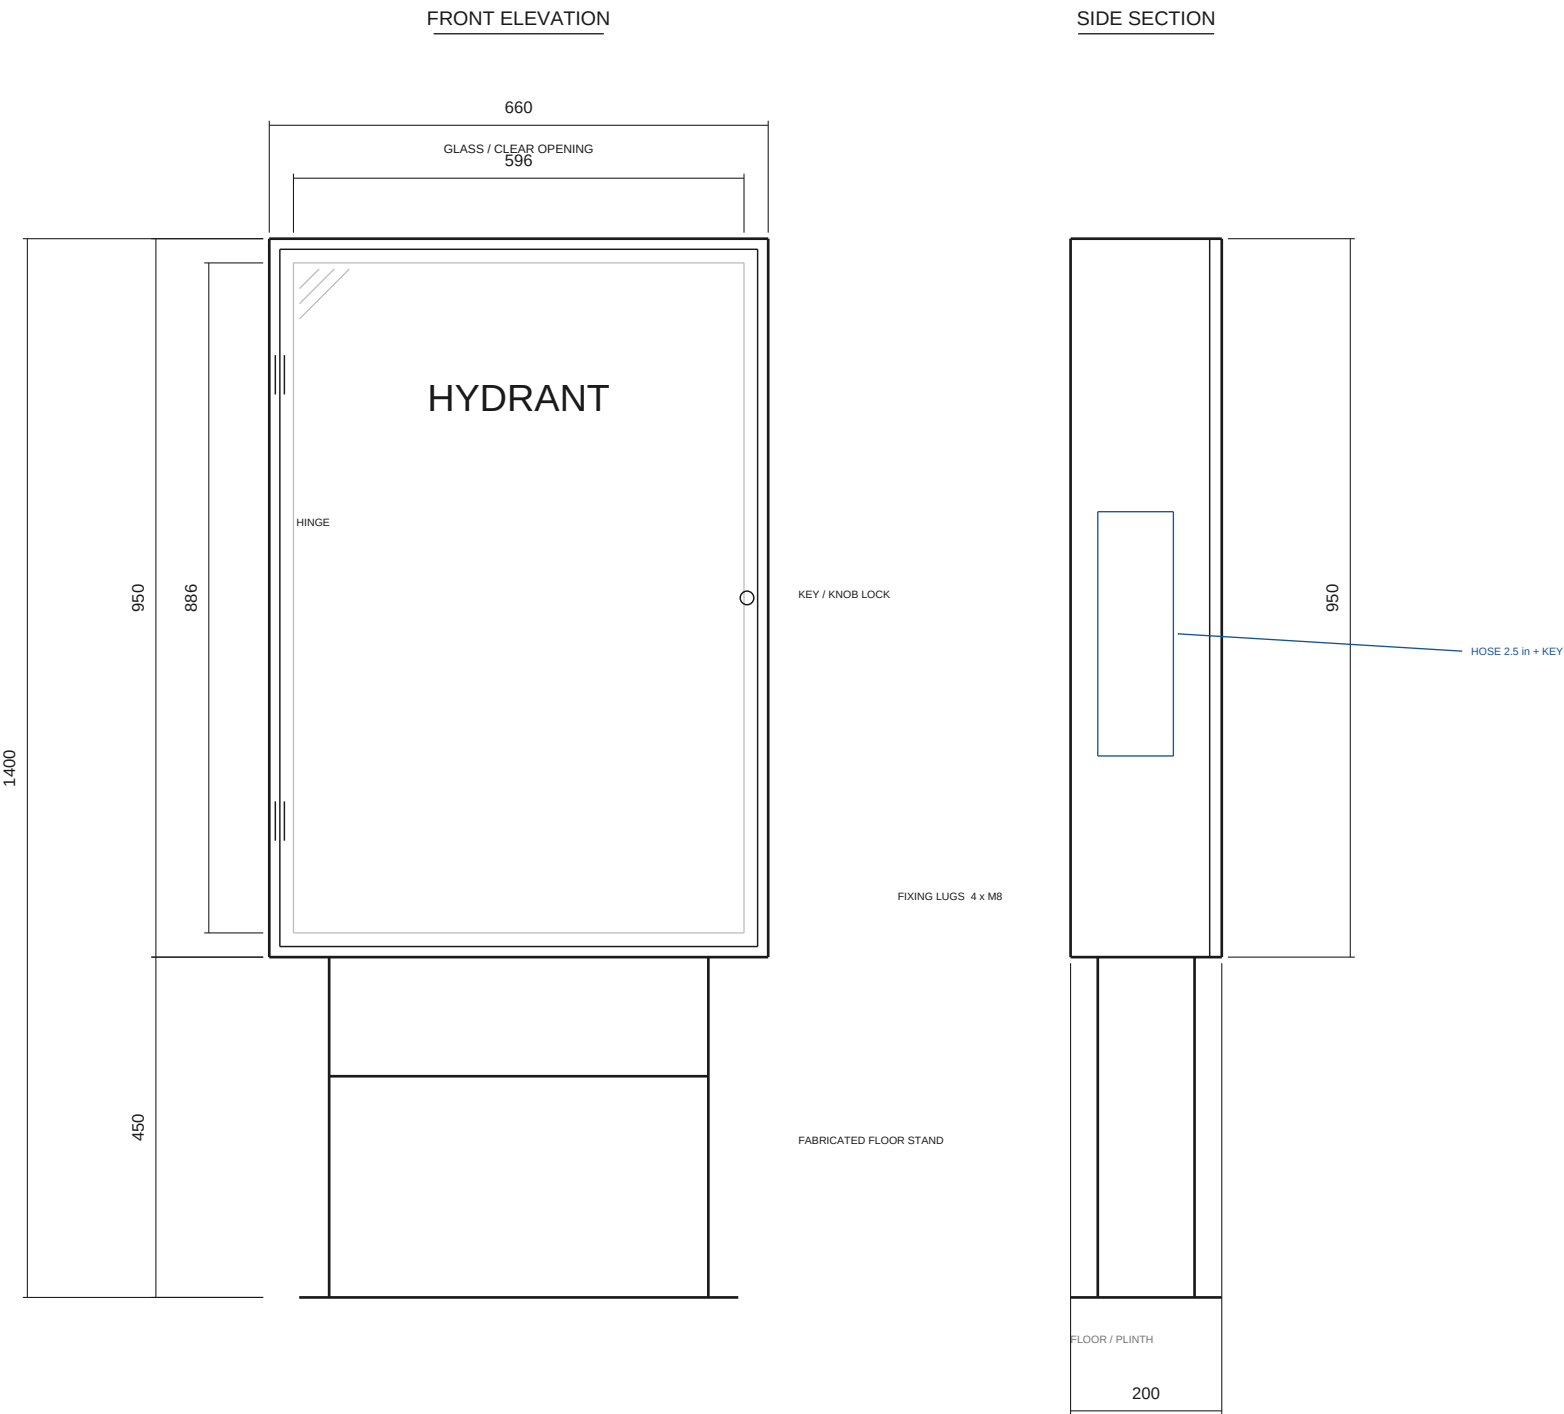

APPLICATION · SK-ID-C

NOMINAL TRADE SIZE

95 x 66 x 20 cm (tinggi x lebar x dalam)

METRIC (W x H x D)

660 x 950 x 200 mm

MOUNTING

FLOOR STANDING ON FABRICATED LEGS (KAKI)

CONTENTS

Selang 2.5 in x 30 m, nozzle 2.5 in, pillar hydrant key

BODY

Plat besi (CRS) 1.2-1.5 mm, powder coating merah

DOOR

Pintu kaca 3 mm with a rubber glazing strip, in a steel door

HARDWARE

Cylinder lock with key, steel hinges

MOUNTING HEIGHT

Box centreline 1200-1500 mm above floor typical; tipe C legs set the door at working height

CODE BASIS

Sizes to the Indonesian tipe A1/A2/B/C convention; installation to SNI 03-1745 and the local Damkar requirement

REMARK

Stands on legs beside the pillar hydrant. Gasketed door and drip lip. 25 cm depth also made.

NOTES

- ALL DIMENSIONS IN MILLIMETRES, WRITTEN W x H x D. INDONESIA CATALOGUES QUOTE CENTIMETRES AS TINGGI x LEBAR x DALAM (HEIGHT x WIDTH x DEPTH) - BOTH ARE SHOWN.
- BODY: PLAT BESI (COLD-ROLLED MILD STEEL) 1.2 mm ON TIPE A1, A2 AND B; 1.2-1.5 mm ON OUTDOOR TIPE C. GALVANISED OR SUS 304 FOR COASTAL SITES.
- FINISH: POWDER COATING MERAH (RED) - THE INDONESIAN CONVENTION. WHITE, YELLOW OR ANY RAL FROM 300 pcs.
- GLAZING: PINTU KACA 3 mm WITH A RUBBER GLAZING STRIP (LIST KARET) - THE LOCAL STANDARD. 5 mm GLASS, POLYCARBONATE OR PINTU POLOS (SOLID STEEL) ON REQUEST.
- HARDWARE: CYLINDER LOCK WITH KEY, STEEL HINGES. BREAK-GLASS OR PADLOCK HASP ON REQUEST.
- LETTERING: "HYDRANT" IN WHITE ON THE RED DOOR. "FIRE HYDRANT", "APAR" OR A BILINGUAL FACE ON REQUEST. TIPE B CARRIES THE ALARM LEGEND ON THE UPPER PANEL.
- TOLERANCE ON OVERALL DIMENSIONS: +/- 2 mm. OUTDOOR TIPE C HAS A GASKETED DOOR, A DRIP LIP AND FABRICATED LEGS (KAKI) TO STAND BESIDE A PILLAR HYDRANT.
- ISI (CONTENTS) ARE BOUGHT-IN ITEMS - SELANG, NOZZLE, HYDRANT VALVE, MACHINO COUPLING, HOSE RACK. SIZES FOLLOW THE TIPE A1 / A2 / B / C CONVENTION USED ON INDONESIAN PROJECTS. WE DO NOT HOLD SNI CERTIFICATION AND DO NOT CLAIM IT.

SOKEI FIRE

Fire hose cabinet manufacturer · sokeifire.com

INDONESIA MARKET

STANDARD SIZE DRAWING PACK

TITLE

BOX HYDRANT TIPE C - 660 x 950 x 200 (OUTDOOR, ON LEGS)

NOMINAL TRADE SIZE

95 x 66 x 20 cm (tinggi x lebar x dalam)

DRAWING No.

SK-ID-C-STD

MOUNTING

ON LEGS

UNITS


mm [inch]

SCALE

1 : 10

FRONT ELEVATION

SIDE SECTION

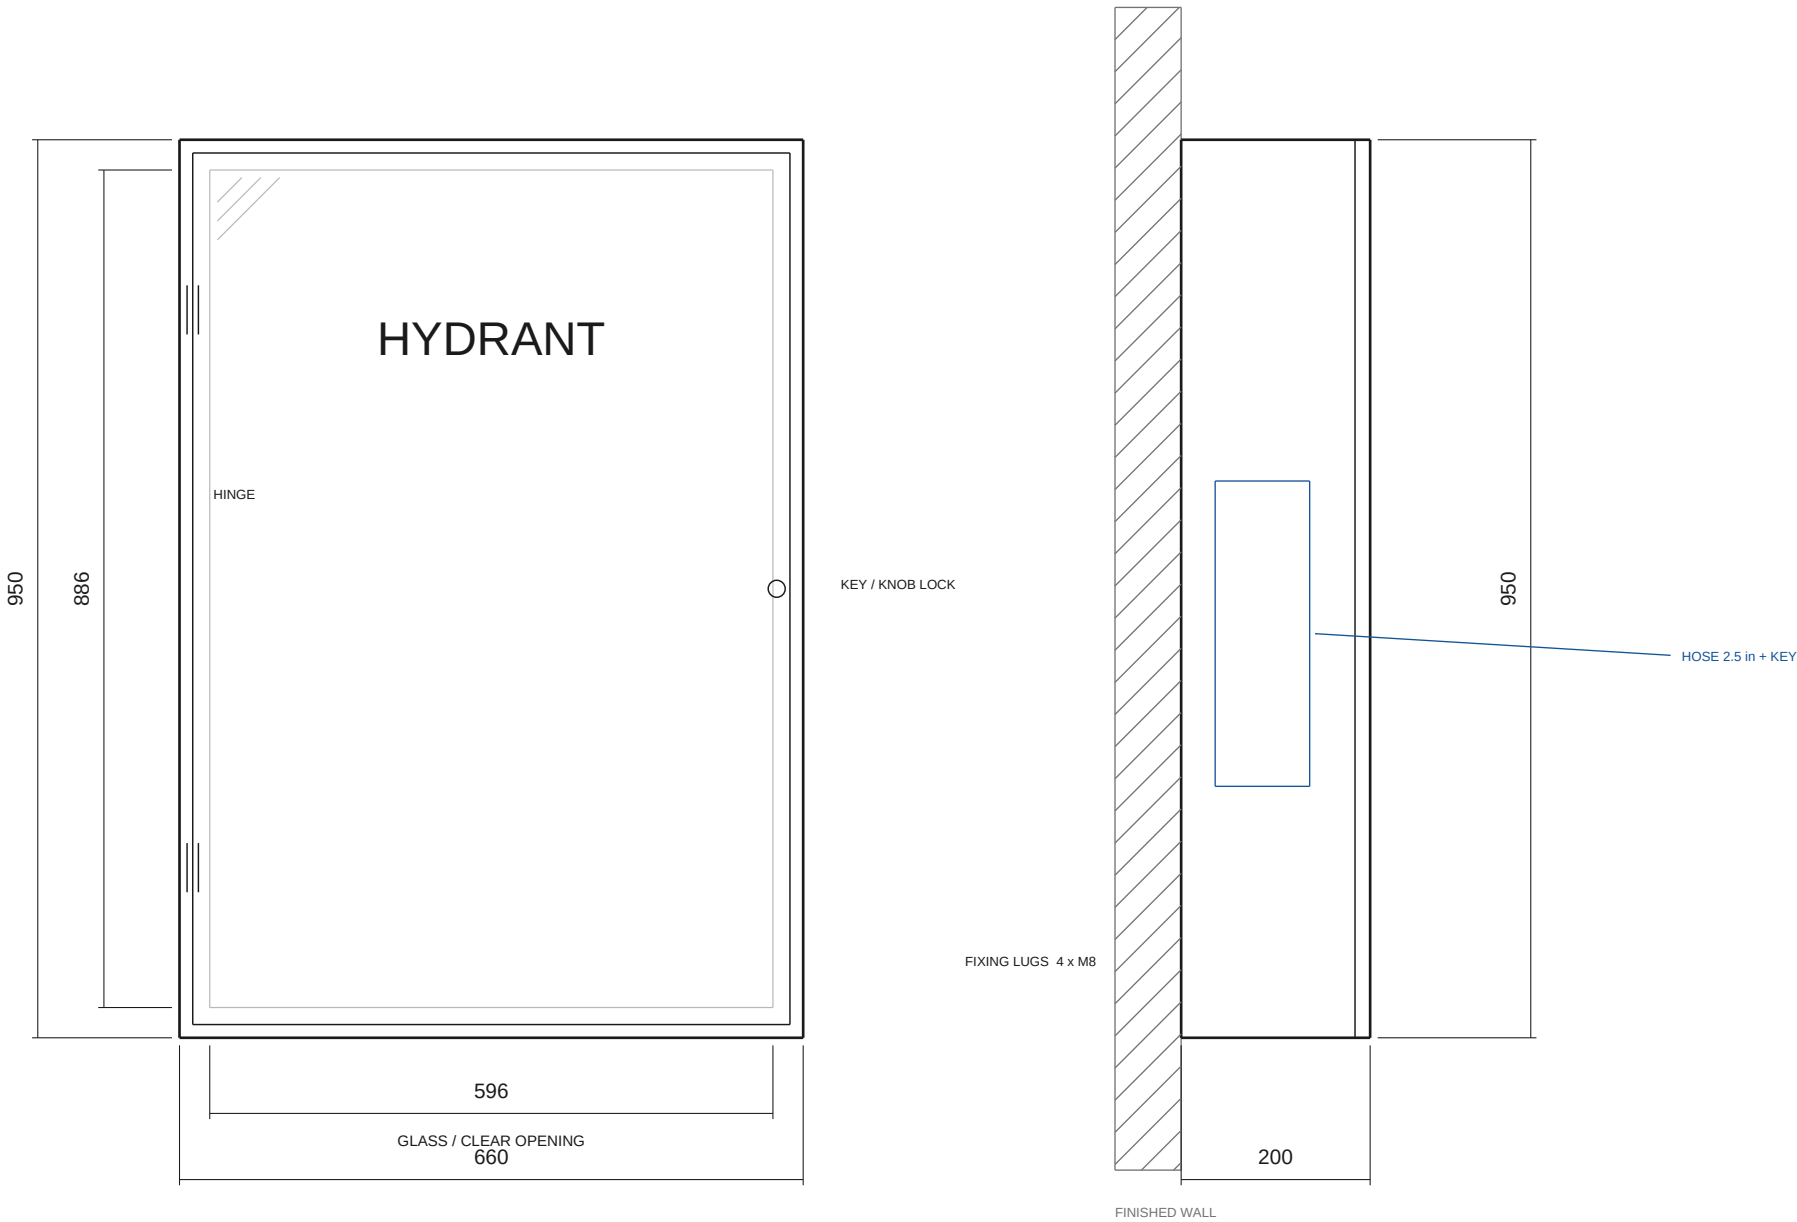

APPLICATION · SK-ID-C-W

- NOMINAL TRADE SIZE**
95 x 66 x 20 cm (tinggi x lebar x dalam)
- METRIC (W x H x D)**
660 x 950 x 200 mm
- MOUNTING**
SURFACE, WALL MOUNTED (EXTERNAL)
- CONTENTS**
Selang 2.5 in x 30 m, nozzle 2.5 in, pillar hydrant key
- BODY**
Plat besi (CRS) 1.2-1.5 mm, powder coating merah
- DOOR**
Pintu kaca 3 mm with a rubber glazing strip, in a steel door
- HARDWARE**
Cylinder lock with key, steel hinges
- MOUNTING HEIGHT**
Box centreline 1200-1500 mm above floor typical; tipe C legs set the door at working height
- CODE BASIS**
Sizes to the Indonesian tipe A1/A2/B/C convention; installation to SNI 03-1745 and the local Damkar requirement
- REMARK**
Same outdoor box fixed to a boundary or plant-room wall instead of legs.

NOTES

- ALL DIMENSIONS IN MILLIMETRES, WRITTEN W x H x D. INDONESIA CATALOGUES QUOTE CENTIMETRES AS TINGGI x LEBAR x DALAM (HEIGHT x WIDTH x DEPTH) - BOTH ARE SHOWN.
- BODY: PLAT BESI (COLD-ROLLED MILD STEEL) 1.2 mm ON TIPE A1, A2 AND B; 1.2-1.5 mm ON OUTDOOR TIPE C. GALVANISED OR SUS 304 FOR COASTAL SITES.
- FINISH: POWDER COATING MERAH (RED) - THE INDONESIA CONVENTION. WHITE, YELLOW OR ANY RAL FROM 300 pcs.
- GLAZING: PINTU KACA 3 mm WITH A RUBBER GLAZING STRIP (LIST KARET) - THE LOCAL STANDARD. 5 mm GLASS, POLYCARBONATE OR PINTU POLOS (SOLID STEEL) ON REQUEST.
- HARDWARE: CYLINDER LOCK WITH KEY, STEEL HINGES. BREAK-GLASS OR PADLOCK HASP ON REQUEST.
- LETTERING: "HYDRANT" IN WHITE ON THE RED DOOR. "FIRE HYDRANT", "APAR" OR A BILINGUAL FACE ON REQUEST. TIPE B CARRIES THE ALARM LEGEND ON THE UPPER PANEL.
- TOLERANCE ON OVERALL DIMENSIONS: +/- 2 mm. OUTDOOR TIPE C HAS A GASKETED DOOR, A DRIP LIP AND FABRICATED LEGS (KAKI) TO STAND BESIDE A PILLAR HYDRANT.
- ISI (CONTENTS) ARE BOUGHT-IN ITEMS - SELANG, NOZZLE, HYDRANT VALVE, MACHINO COUPLING, HOSE RACK. SIZES FOLLOW THE TIPE A1 / A2 / B / C CONVENTION USED ON INDONESIA PROJECTS. WE DO NOT HOLD SNI CERTIFICATION AND DO NOT CLAIM IT.

SOKEI FIRE

Fire hose cabinet manufacturer · sokeifire.com

INDONESIA MARKET
STANDARD SIZE DRAWING PACK

TITLE BOX HYDRANT TIPE C - 660 x 950 x 200 (OUTDOOR, WALL MOUNTED)		NOMINAL TRADE SIZE 95 x 66 x 20 cm (tinggi x lebar x dalam)	
DRAWING No. SK-ID-C-SUR	MOUNTING SURFACE	UNITS mm [inch]	SCALE 1 : 8